


FRONT (INSIDE) VIEW

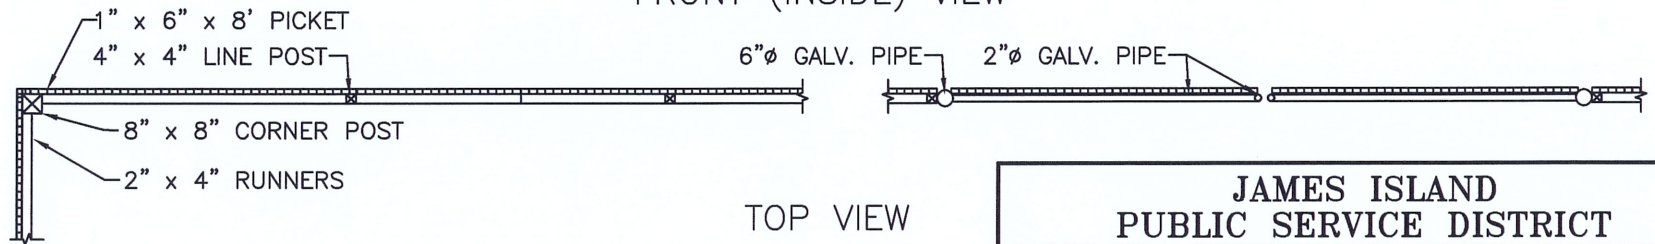

TOP VIEW

NOTES:

1. ALL WOOD SHALL BE PRESSURE TREATED.
2. ALL HARDWARE SHALL BE GALVANIZED.
3. ALL CORNER POSTS, LINE POSTS AND GATE POSTS SHALL BE SET IN 3000psi CONCRETE FOOTINGS AS SHOWN.
4. GATE SHALL BE EQUIPPED WITH A PROP POST CENTER LATCH AND HASP ASSEMBLY. A GROUND ANCHOR CAST IN CONCRETE SHALL BE PROVIDED.

JAMES ISLAND PUBLIC SERVICE DISTRICT	
WOODEN FENCE	DRAWING: 15
DATE: <u>8/10/06</u>	DRAWN BY: <u>MJF</u>
SCALE: <u>NTS</u>	APPROVED BY: <u>EWK</u>