

NOTICE:


1. MAXIMUM SITE GRADING FROM WET WELL TOP SLAB TO ASPHALT SURFACE PERIMETER SHALL BE 1% UNLESS APPROVED OTHERWISE
2. EXTEND PAVEMENT TO FENCE LINE UNLESS APPROVED OTHERWISE

NOTICE:

SEE DISTRICT STANDARDS, SECTIONS 11, 12, & 13 FOR ADDITIONAL REQUIREMENTS

NOTICE:

PUMP STATION GRADING SHALL PROVIDE POSITIVE DRAINAGE SUBJECT TO DISTRICT REVIEW AND APPROVAL

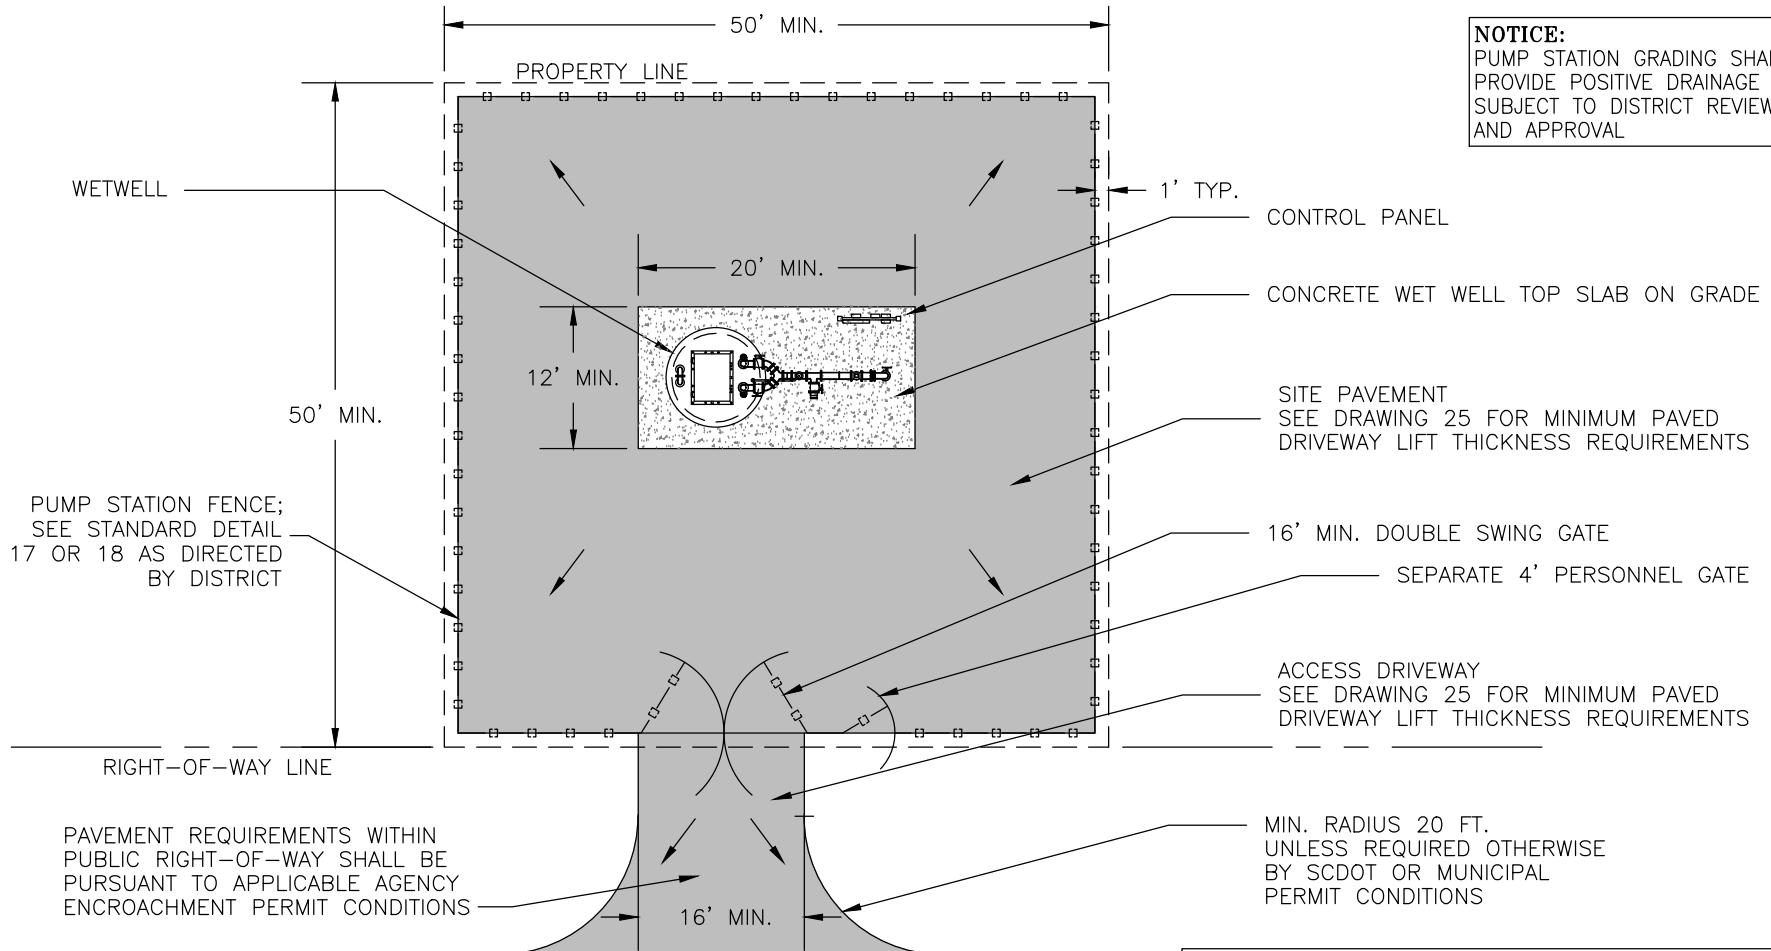

**JAMES ISLAND
PUBLIC SERVICE DISTRICT**

TYPICAL PUMP STATION
SITE PLAN

DRAWING:

12

DATE: 05/24/16

DRAWN BY: GRG & ASSOC., INC

SCALE: NTS

APPROVED BY: DJH