


NOTICE:

ALL DUCTILE IRON PIPE AND FITTINGS SHALL BE P-401 LINED AND ENCASED IN POLYETHYLENE AS REQUIRED PURSUANT TO APPLICABLE PROJECT SPECIFICATIONS AND IN ACCORDANCE WITH AWWA C105.

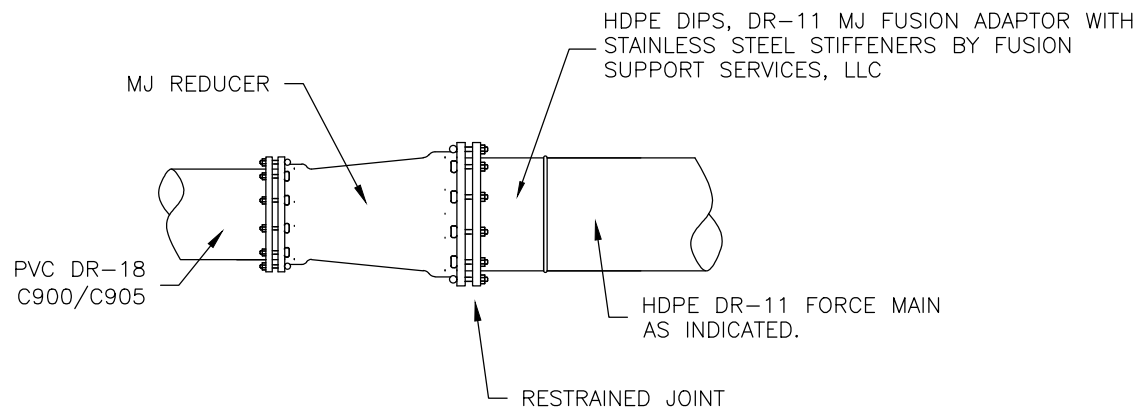

**JAMES ISLAND
PUBLIC SERVICE DISTRICT**

HDPE TRANSITION

DRAWING:

28

DATE: 05/24/16

DRAWN BY: GRC & ASSOC., INC

SCALE: NTS

APPROVED BY: DJH