


ANCHORAGE SCHEDULE				
VALVE	SQ. FT.	"D"	"X"	"Y"
3"Ø	0.3	7.5"	4"	9"
4"Ø	0.4	9"	5"	11"
6"Ø	0.8	13"	7"	16"
8"Ø	1.2	17"	8"	21"

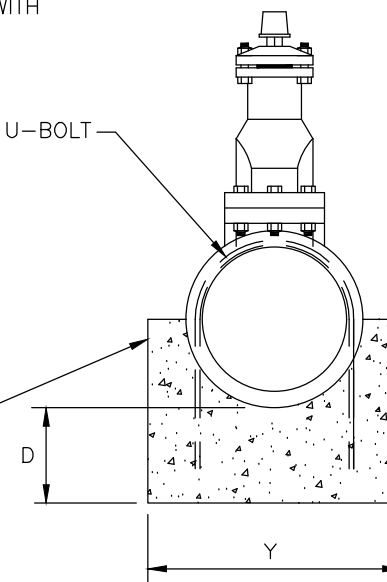

NOTICE:
ALL PLUG VALVES 4" DIAMETER
AND LARGER SHALL BE GEAR OPERATED

NOTICE:
SEE DISTRICT STANDARDS,
SECTION 8D & 12E FOR
ADDITIONAL REQUIREMENTS

JAMES ISLAND PUBLIC SERVICE DISTRICT

VALVE AND VALVE BOX

DRAWING:

1

DATE: 05/24/16

DRAWN BY: GRC & ASSOC., INC

SCALE: NTS

APPROVED BY: DJH